


PLAN VIEW

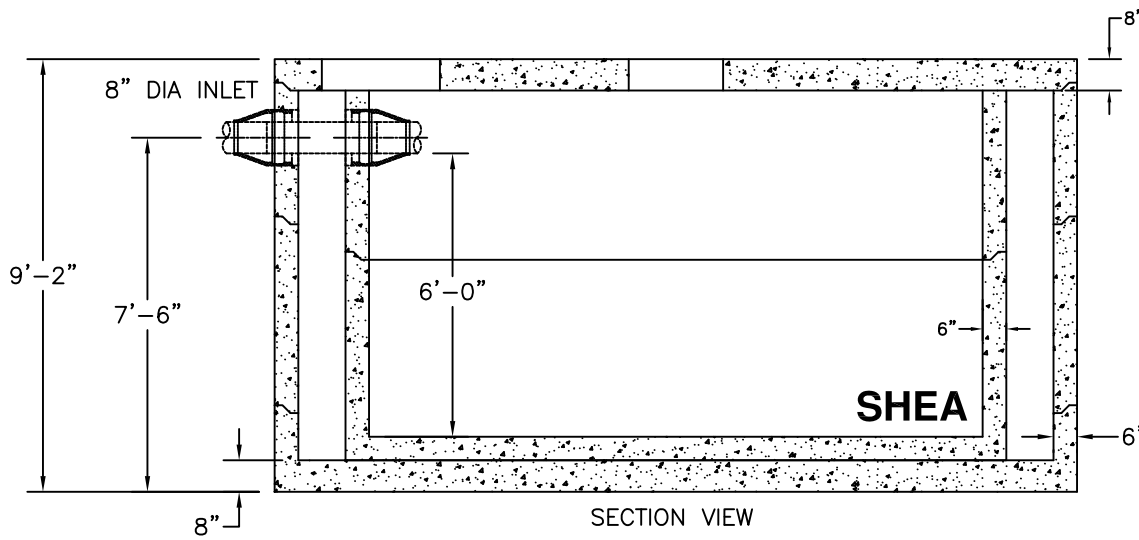

SECTION VIEW

NOTES:

1. CONCRETE: 5,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR 15.00, DEP TITLE 5 REGS, FOR SEPTIC TANKS.
3. ALL REINFORCEMENT PER ASTM C1227-93.
4. DESIGNED FOR H-20 LOADING.
5. TONGUE & GROOVE JOINT SEALED WITH BUTYLE RESIN.
6. TEES AND BAFFLES SOLD SEPARATELY.



*New England's Premier Precaster*  
 800-696-7432 (SHEA)  
 www.sheaconcrete.com

DOUBLE WALL TANK  
 4000 GALLON

773 Salem Street  
 P.O. Box 520  
 Wilmington, MA 01887

87 Haverhill Road  
 P.O. Box 807  
 Amesbury, MA 01913

160 Old Turnpike Road  
 Nottingham, NH 03290

Page:

