


PLAN

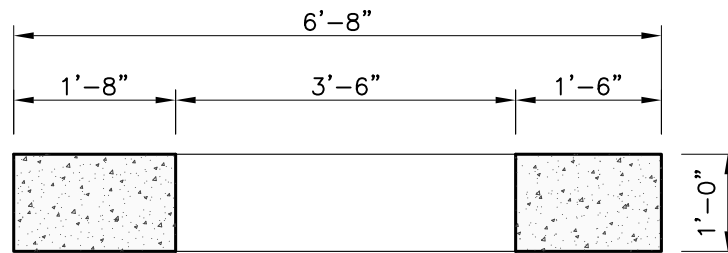

SECTION A-A

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. STEEL REINFORCEMENT – ASTM A615, GRADE 60., 1" MIN. COVER.
3. ALL MATERIAL CONFORM TO ACI-318.
4. THREE PHASE-15 KV. 75-500 kVA.
5. EDGING WILL BE DONE ON ALL FOUR SIDES.



New England's Premier Precaster

800-696-7432 (SHEA)
www.sheaconcrete.com

BOSTON EDISON/CAMBRIDGE
75-300 kVA TRANSFORMER PAD

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA
87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH

Mail to: PO Box 520-Wilmington, MA 01887

Page: K7.1

BE 75 300 KVA.dwg

01/01/2013

