


PLAN

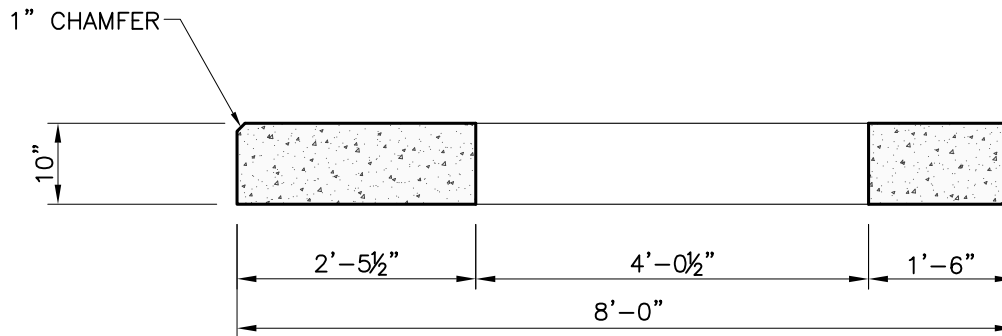

SECTION A-A

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. STEEL REINFORCEMENT – ASTM A615, GRADE 60., 1” MIN. COVER.
3. REINFORCEMENT #4 REBAR 12” O.C. BOTH WAYS.



New England's Premier Precaster
 800-696-7432 (SHEA)
 www.sheaconcrete.com

CONCORD MUNICIPAL LIGHT
 300KVA & 225KVA TRANSFORMER PAD

773 Salem Street—Wilmington, MA 153 Cranberry Hwy—Rochester, MA
 87 Haverhill Road—Amesbury, MA 160 Old Turnpike Rd—Nottingham, NH
 Mail to: PO Box 520—Wilmington, MA 01887

Page: K7.5

CMLP300KVATP.dwg

01/01/2013

