


PLAN VIEW

—TOPS OF TANKS NOT SHOWN FOR CLARITY—

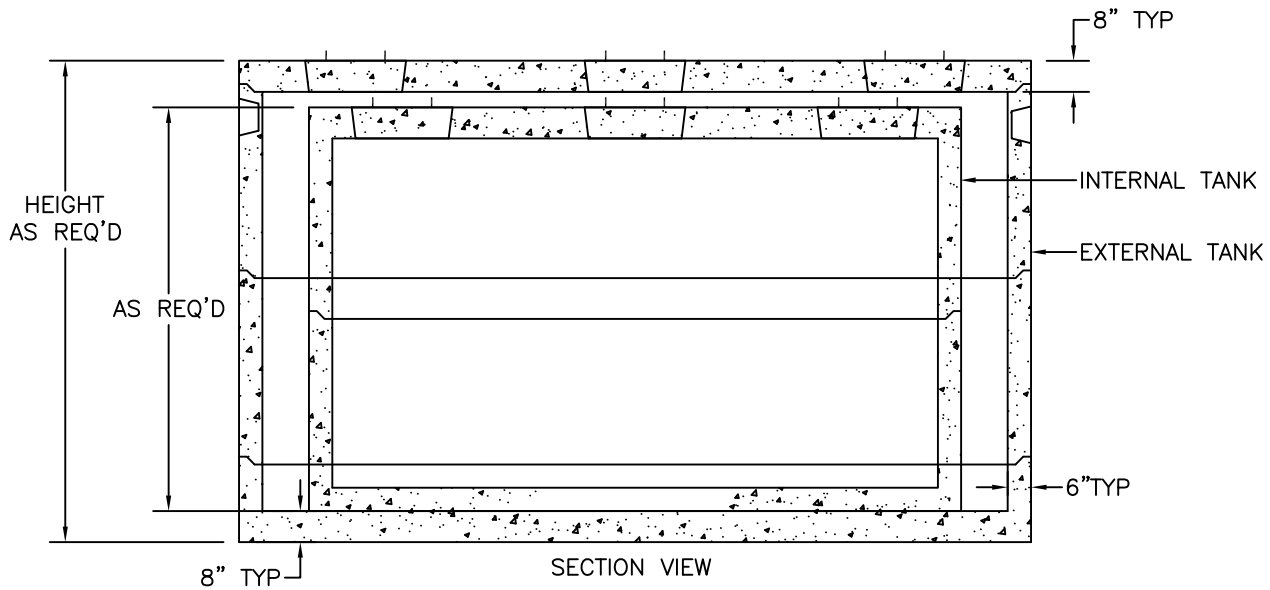

SECTION VIEW

NOTES:

1. CONCRETE: 5,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR 15.00, DEP TITLE 5 REGS, FOR SEPTIC TANKS.
3. ALL REINFORCEMENT PER ASTM C1227.
4. DESIGNED FOR H-20 LOADING, COVER 1-5 FT.
5. TONGUE AND GROOVE JOINT SEALED WITH BUTYL RESIN. INLET HEIGHT MAY INCREASE SLIGHTLY DUE TO THE BUTYL RESIN USED.



New England's Premier Precaster
 800-696-7432 (SHEA)
 www.sheaconcrete.com

DOUBLE CELL TANK
 (SIZING AS REQUIRED)

773 Salem Street—Wilmington, MA 153 Cranberry Hwy—Rochester, MA
 87 Haverhill Road—Amesbury, MA 160 Old Turnpike Rd—Nottingham, NH
 Mail to: PO Box 520—Wilmington, MA 01887

Page: I11

DoubleCellTank.dwg 02/01/2013

