


SECTION A-A

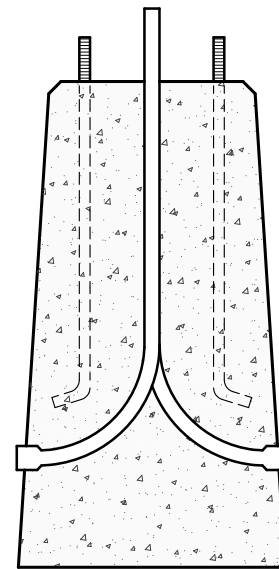

SECTION B-B

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. CONDUIT, ANCHOR BOLTS AND TEMPLATE SUPPLIED BY OTHERS.
3. STEEL REINFORCEMENT, ASTM-A615, GRADE 60, 1" MIN. COVER.



New England's Premier Precaster
 800-696-7432 (SHEA)
 www.sheaconcrete.com

FE-9 LIGHT POLE FOUNDATION
 17"x22"x40H

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA
 87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH
 Mail to: PO Box 520-Wilmington, MA 01887

Page: K1.5

LPFoundation-17x22x40.dwg

01/01/2013

