


SECTION A-A

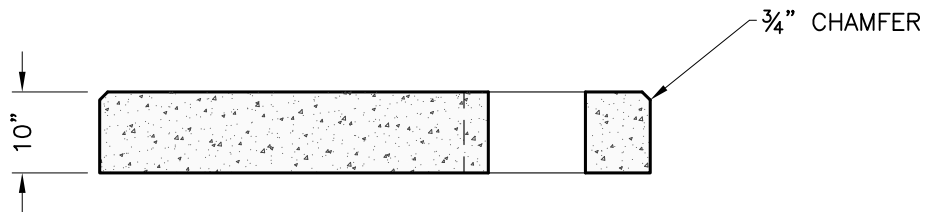

SECTION B-B

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. ALL REINFORCEMENT PER ASTM A-615
3. ALL MATERIAL CONFORM TO ACI-318.
4. THREE PHASE-15 KV. 75-500 kVA.



*New England's Premier Precaster*

800-696-7432 (SHEA)  
www.sheaconcrete.com

NATIONAL GRID  
75-500 kVA TRANSFORMER PAD

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA  
87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH

Mail to: PO Box 520-Wilmington, MA 01887

Page: K5.1

NG75-500kVA.dwg

01/01/2013

