



PLAN

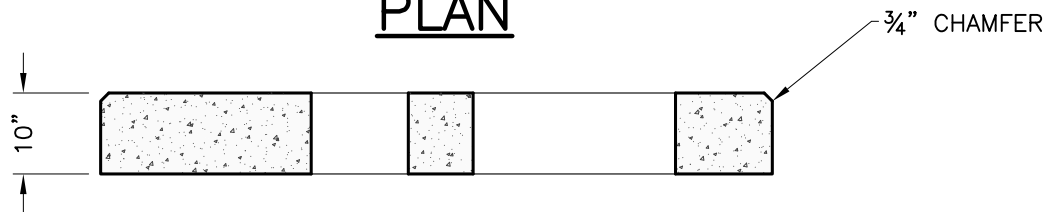

SECTION A-A

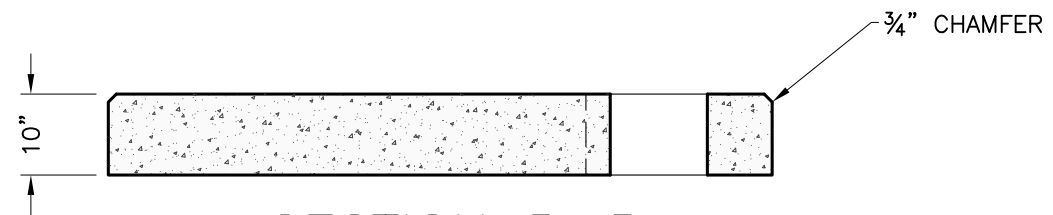

SECTION B-B

		WEIGHT
ITEM NO.	UTL-NG2500KVA	5,400LBS

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. KEEP 3' AWAY FROM EDGE OF SIDEWALK AND 8' FROM EDGE OF ROADWAY.
3. ALL REINFORCEMENT PER ASTM A-615
4. THREE PHASE-15 kV MAXIMUM. 750-1000 kVA-KVA-208Y/120 750-2500 kVA-480Y/277.



New England's Premier Precaster
 800-696-7432 (SHEA)
 www.sheaconcrete.com

NATIONAL GRID
 750-2500 kVA TRANSFORMER PAD

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA
 87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH
 Mail to: PO Box 520-Wilmington, MA 01887

Page: K5.3

NG750-2500kVA.dwg

01/01/2013

