


**PLAN**

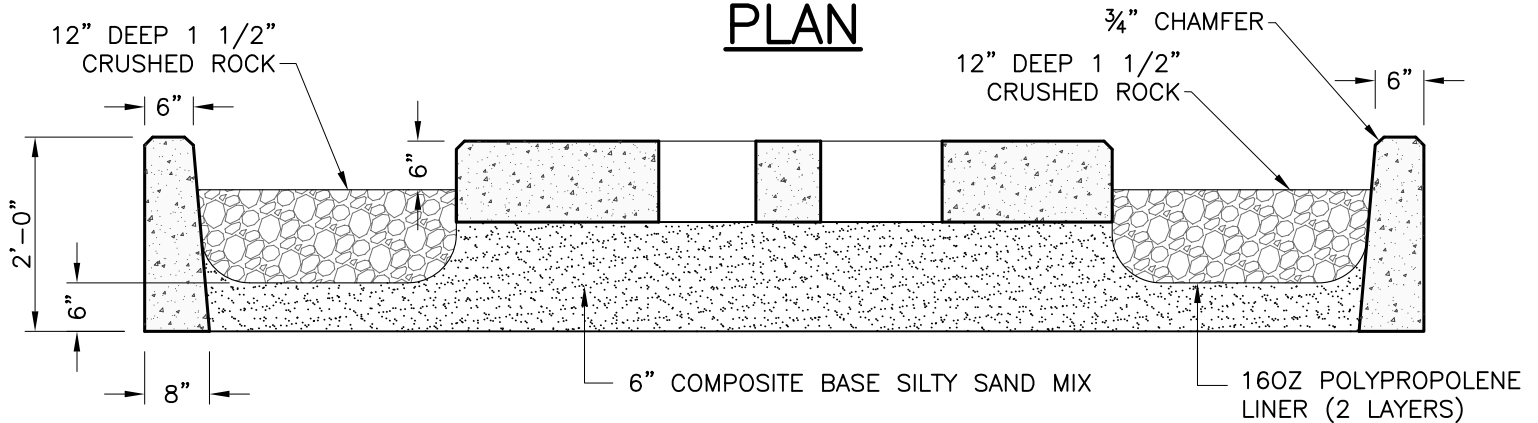

**SECTION A-A**

NOTES:

1. CONCRETE MINIMUM STRENGTH 4,000 PSI AFTER 28 DAYS.
2. ALL REINFORCEMENT #5 REBAR.
3. ALL MATERIAL CONFORM TO ACI-318.
4. REFER TO NG OIL CONTAINMENT SPEC.
5. REFER TO PAGE K5.1 FOR PAD DIMENSIONS.



*New England's Premier Precaster*  
 800-696-7432 (SHEA)  
 www.sheaconcrete.com

**NATIONAL GRID OIL CURB  
 FOR 75-500 kVA TRANSFORMER PAD**

773 Salem Street—Wilmington, MA 153 Cranberry Hwy—Rochester, MA  
 87 Haverhill Road—Amesbury, MA 160 Old Turnpike Rd—Nottingham, NH  
 Mail to: PO Box 520—Wilmington, MA 01887

Page: K5.2

NGCURB500kVA.dwg

01/01/2013

