


PLAN

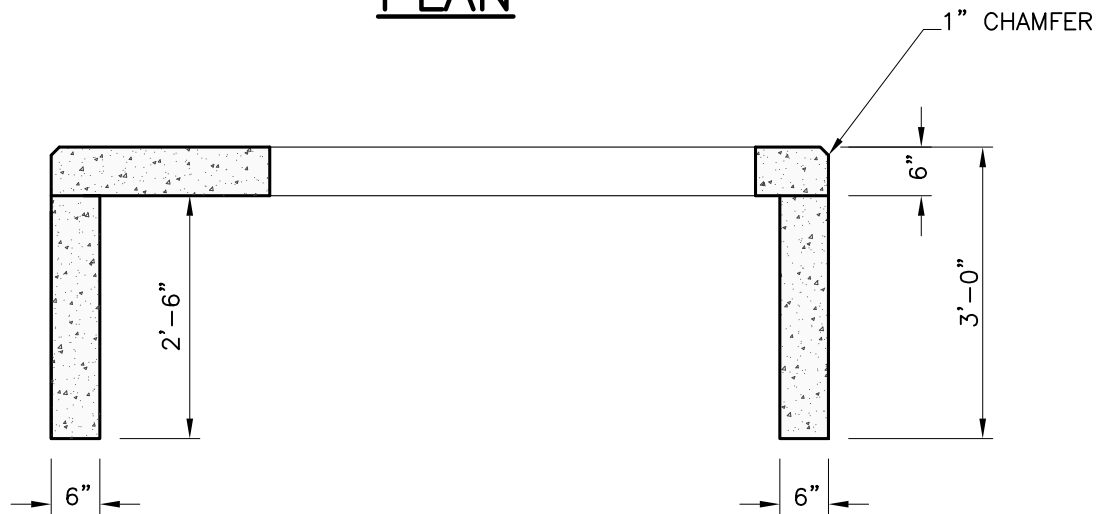

SECTION A-A

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. STEEL REINFORCEMENT - ASTM A615, GRADE 60, 1" MIN. COVER.



New England's Premier Precaster
 800-696-7432 (SHEA)
 www.sheaconcrete.com

NGRID MS 2585 TRANSFORMER VAULT
 84" x 96" x 2'-6"
 500-2500 KVA

