


PLAN

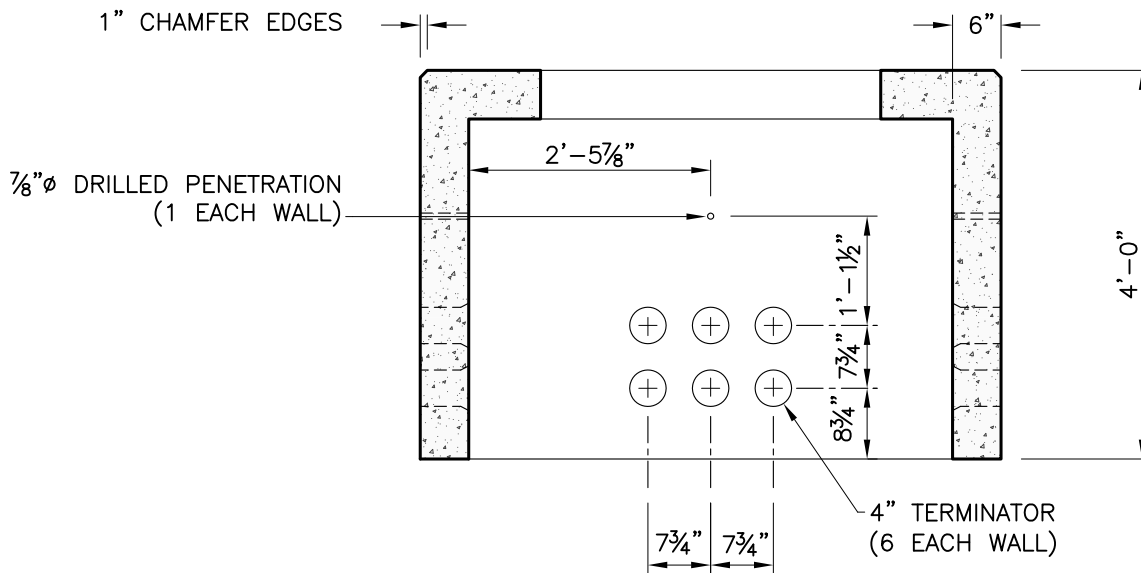

SECTION A-A

(TYPICAL ELEVATION ALL 4 WALLS)

NOTES:

1. CONCRETE MIN. STRENGTH – 5,000 PSI @ 28 DAYS.
2. STEEL REINFORCEMENT – ASTM A615, GRADE 60.
3. MINIMUM STEEL COVER – 1 INCH TYPICAL.
4. DESIGN LOADING – AASHTO HS20-44.
5. DESIGN SPECIFICATIONS – ACI 318 & AASHTO LOAD FACTOR DESIGN METHOD.
6. TERMINATORS SHALL HAVE BELL ENDS FLUSH WITH INSIDE WALL.



New England's Premier Precaster
 800-696-7432 (SHEA)
 www.sheaconcrete.com

NSTAR 3PH TRANSFORMER VAULT
 150-300 KVA

773 Salem Street—Wilmington, MA 153 Cranberry Hwy—Rochester, MA
 87 Haverhill Road—Amesbury, MA 160 Old Turnpike Rd—Nottingham, NH
 Mail to: PO Box 520—Wilmington, MA 01887

Page: K6.22

NSTAR 3PH TV 150-300KVA.dwg 01/01/2013

