


SECTION A-A

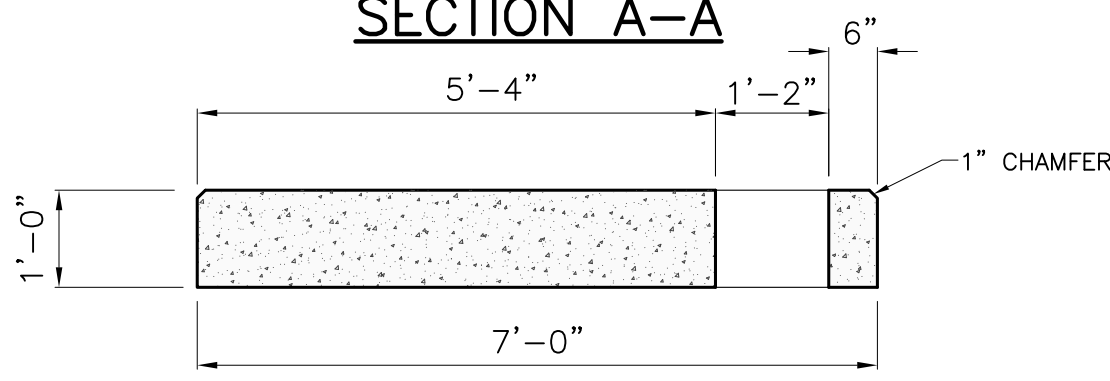

SECTION B-B

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. STEEL REINFORCEMENT - ASTM A615, GRADE 60.
3. MINIMUM STEEL COVER - 1 INCH.

	<p><i>New England's Premier Precaster</i> 800-696-7432 (SHEA) www.sheaconcrete.com</p>	<p>NSTAR TRANSFORMER PAD M3803 84" X 65" X 12" 75-500 KVA</p>
<p>773 Salem Street-Wilmington, MA 87 Haverhill Road-Amesbury, MA</p>	<p>153 Cranberry Hwy-Rochester, MA 160 Old Turnpike Rd-Nottingham, NH</p>	<p>Page: K6.19 NSTAR TP M3803.dwg 01/01/2013</p>
<p>Mail to: PO Box 520-Wilmington, MA 01887</p>		