


SECTION A-A

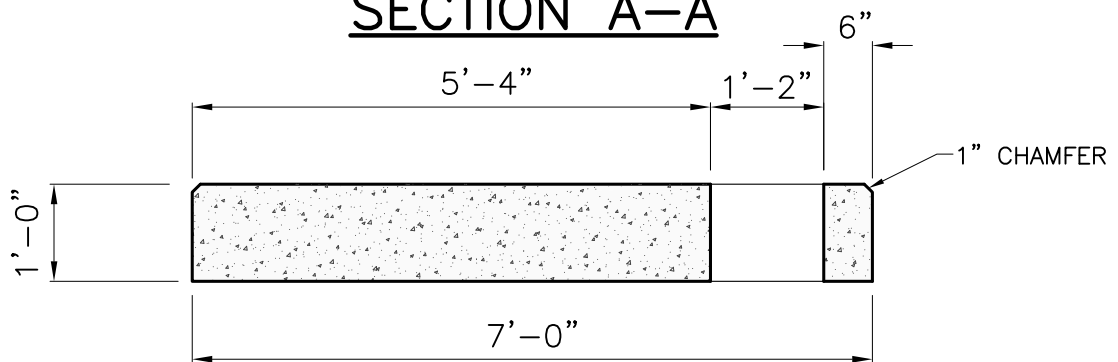

SECTION B-B

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. STEEL REINFORCEMENT - ASTM A615, GRADE 60.
3. MINIMUM STEEL COVER - 1 INCH.



New England's Premier Precaster
800-696-7432 (SHEA)
www.sheaconcrete.com

NSTAR TRANSFORMER PAD M3803
84" X 65" X 12"
75-500 KVA

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA
87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH
Mail to: PO Box 520-Wilmington, MA 01887

Page: K6.19

NSTAR TP M3803.dwg

01/01/2013

