


## PLAN

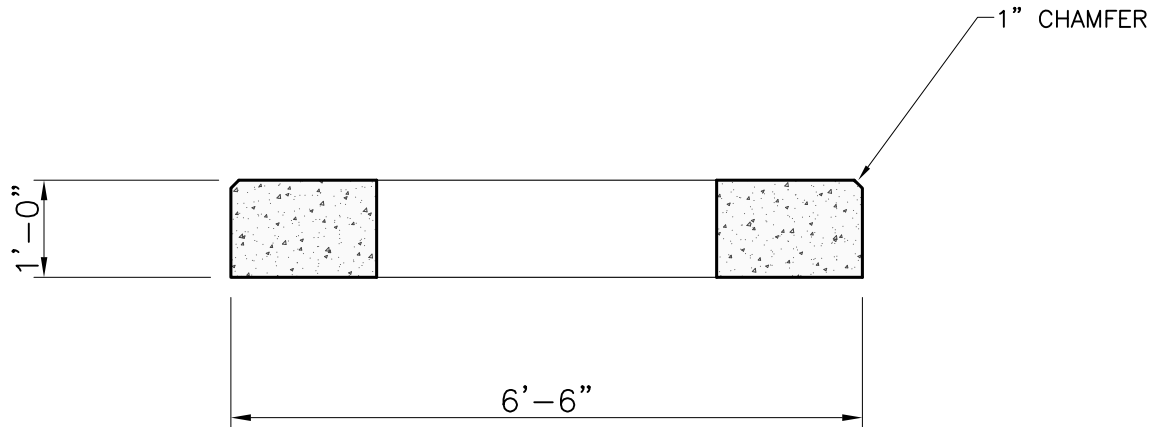

## SECTION A-A

### NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. STEEL REINFORCEMENT - ASTM A615, GRADE 60.
3. MINIMUM STEEL COVER - 1 INCH.



*New England's Premier Precaster*  
 800-696-7432 (SHEA)  
 www.sheaconcrete.com

NSTAR TRANSFORMER PAD  
 M3801-1

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA  
 87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH  
 Mail to: PO Box 520-Wilmington, MA 01887

Page: K6.16

NSTAR TP M3801-1.dwg

01/01/2013

