


PLAN

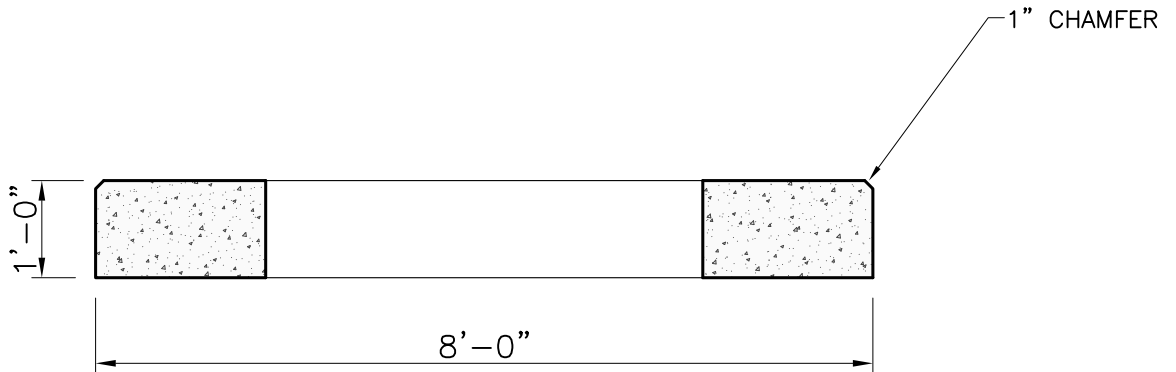

SECTION A-A

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. STEEL REINFORCEMENT - ASTM A615, GRADE 60.
3. MINIMUM STEEL COVER - 1 INCH.



New England's Premier Precaster

800-696-7432 (SHEA)
www.sheaconcrete.com

NSTAR TRANSFORMER PAD
M3801-2

773 Salem Street-Wilmington, MA 01897
87 Haverhill Road-Amesbury, MA 01825
153 Cranberry Hwy-Rochester, MA 01867
160 Old Turnpike Rd-Nottingham, NH 03055
Mail to: PO Box 520-Wilmington, MA 01887

Page: K6.18

NSTAR TP M3801-2.dwg

01/01/2013

