


PLAN

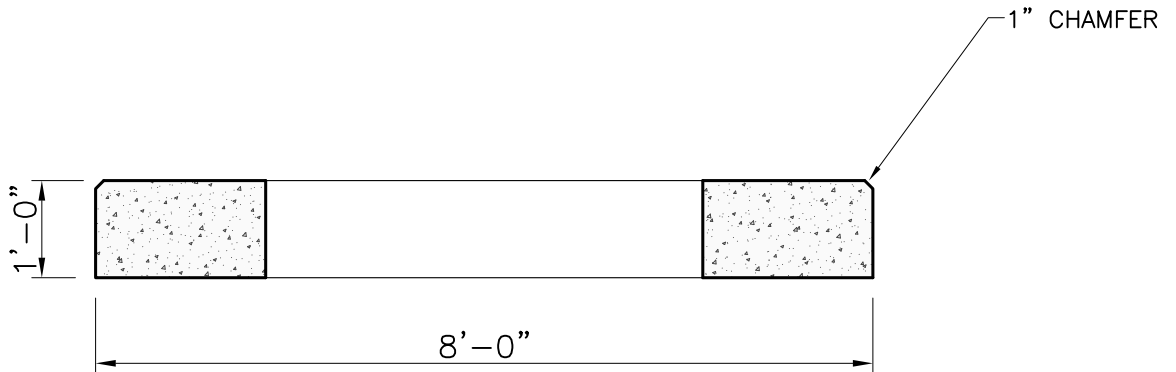

SECTION A-A

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. STEEL REINFORCEMENT - ASTM A615, GRADE 60.
3. MINIMUM STEEL COVER - 1 INCH.



*New England's Premier Precaster*  
 800-696-7432 (SHEA)  
 www.sheaconcrete.com

NSTAR TRANSFORMER PAD  
 M3801-2

