


PLAN

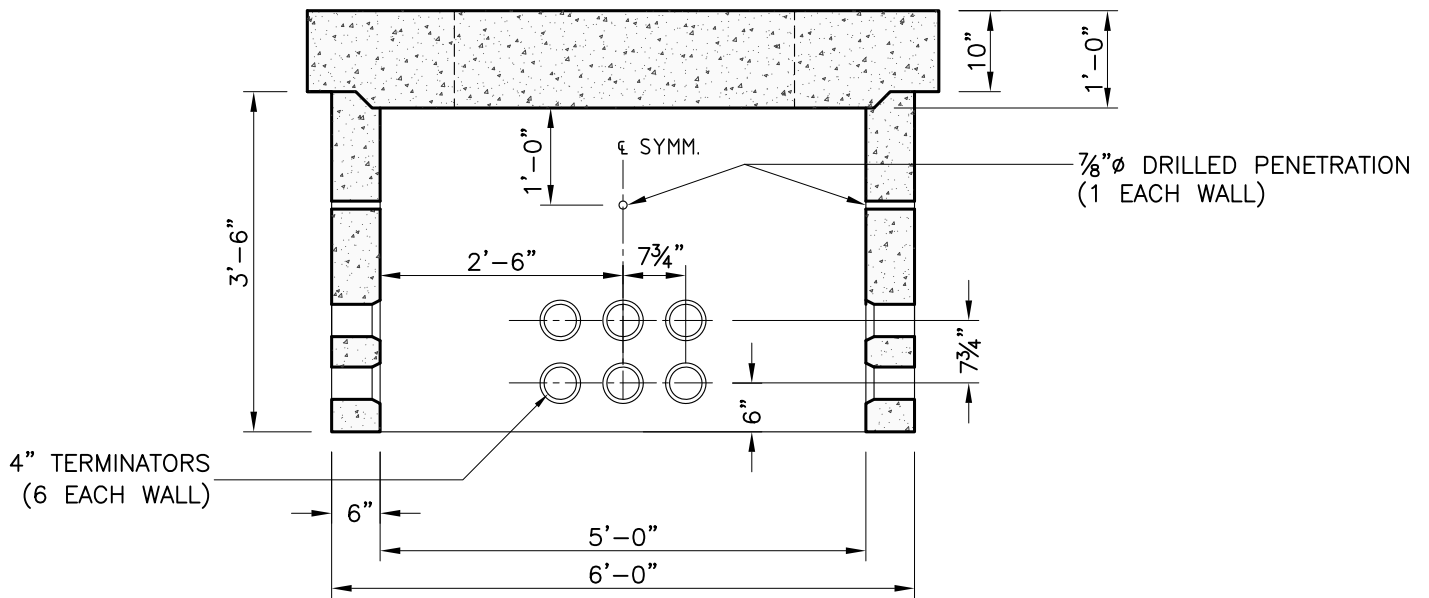

SECTION A-A

TYPICAL WALLS ELEVATION

NOTES:

1. CONCRETE MIN. STRENGTH - 5,000 PSI @ 28 DAYS.
2. STEEL REINFORCEMENT - ASTM A615, GRADE 60.
3. MINIMUM STEEL COVER - 1-1/2 INCH TYPICAL.
4. DESIGN LOADING - AASHTO HS20-44.
5. DESIGN SPECIFICATIONS - ACI 318 & AASHTO LOAD FACTOR DESIGN METHOD.
6. TERMINATORS SHALL HAVE BELL ENDS FLUSH WITH INSIDE WALL.
7. CONSTRUCTION JOINT SHALL BE SEALED WITH 1" ϕ BUTYL RUBBER OR APPROVED EQUAL.



New England's Premier Precaster

800-696-7432 (SHEA)

www.sheaconcrete.com

NSTAR VAULT M3801-1
UP TO 500 KVA

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA
87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH

Mail to: PO Box 520-Wilmington, MA 01887

Page: K6.15

NSTAR VAULT M3801-1.dwg 01/01/2013

