


PLAN

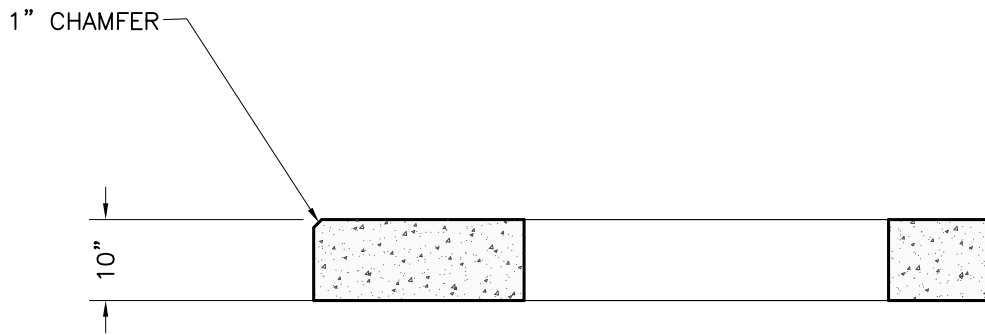

SECTION A-A

NOTES:

1. CONCRETE MINIMUM STRENGTH 5,000 PSI AFTER 28 DAYS.
2. STEEL REINFORCEMENT - ASTM A615, GRADE 60., 1" MIN. COVER.
3. REINFORCEMENT #4 REBAR 12" O.C. BOTH WAYS.

WEIGHT

ITEM NO. UTL-PL750KVA	5,600#
-----------------------	--------



New England's Premier Precaster
 800-696-7432 (SHEA)
 www.sheaconcrete.com

PEABODY MUNICIPAL LIGHT
 750-1500KVA TRANSFORMER PAD

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA
 87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH
 Mail to: PO Box 520-Wilmington, MA 01887

Page: K7. 4

PL750-1500 kVA.dwg

01/01/2013

