


SECTION A-A

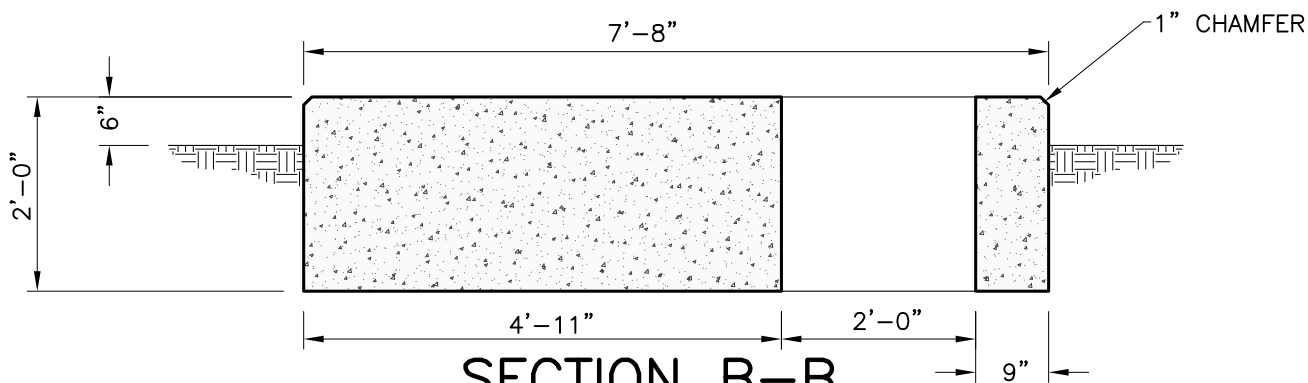

SECTION B-B

NOTES:

1. CONCRETE MINIMUM STRENGTH 4,000 PSI AFTER 28 DAYS.
2. REINFORCEMENT: #5 REBAR.
3. 75 TO 500 KVA 3 ϕ .
4. MEETS PUBLIC SERVICE OF N.H. SPECS.

WEIGHT

ITEM NO. PSNH500KV24	14,385 LBS
----------------------	------------



New England's Premier Precaster
 800-696-7432 (SHEA)
 www.sheaconcrete.com

PSNH TRANSFORMER PAD
 3PH 75 TO 500 KVA

773 Salem Street—Wilmington, MA 153 Cranberry Hwy—Rochester, MA
 87 Haverhill Road—Amesbury, MA 160 Old Turnpike Rd—Nottingham, NH
 Mail to: PO Box 520—Wilmington, MA 01887

Page: K3.5

PSNH500kv24.dwg

01/01/2013

