


PLAN

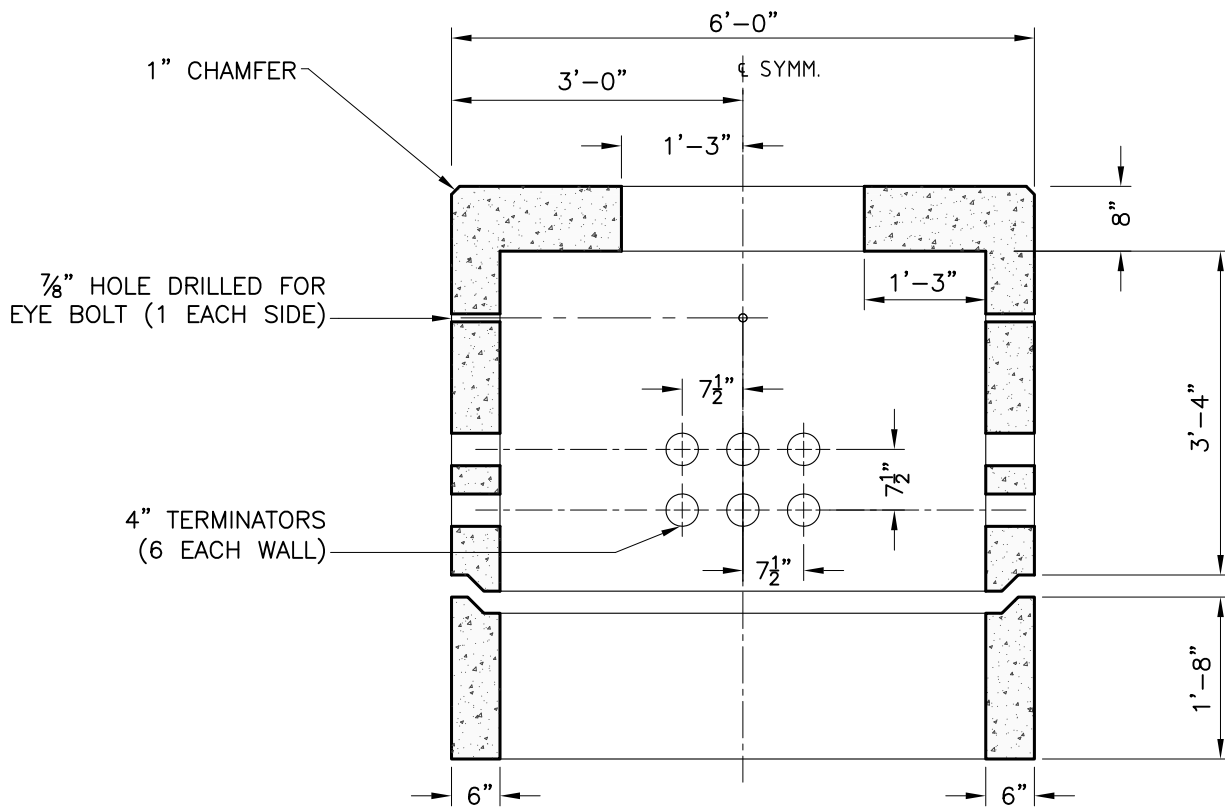

SECTION A-A

NOTES:

1. CONCRETE: 5,000 PSI MINIMUM AFTER 28 DAYS.
2. STEEL REINFORCEMENT CONFORMS TO ASTM A615, GRADE 60.



New England's Premier Precaster
800-696-7432 (SHEA)
www.sheaconcrete.com

PULL BOX

5'-0" W x 5'-0" L x 5'-0" H

773 Salem Street—Wilmington, MA 153 Cranberry Hwy—Rochester, MA
87 Haverhill Road—Amesbury, MA 160 Old Turnpike Rd—Nottingham, NH
Mail to: PO Box 520—Wilmington, MA 01887

Page: K2.8

PULL_BOX_5X5X5.dwg

01/01/2013

