



PLAN VIEW

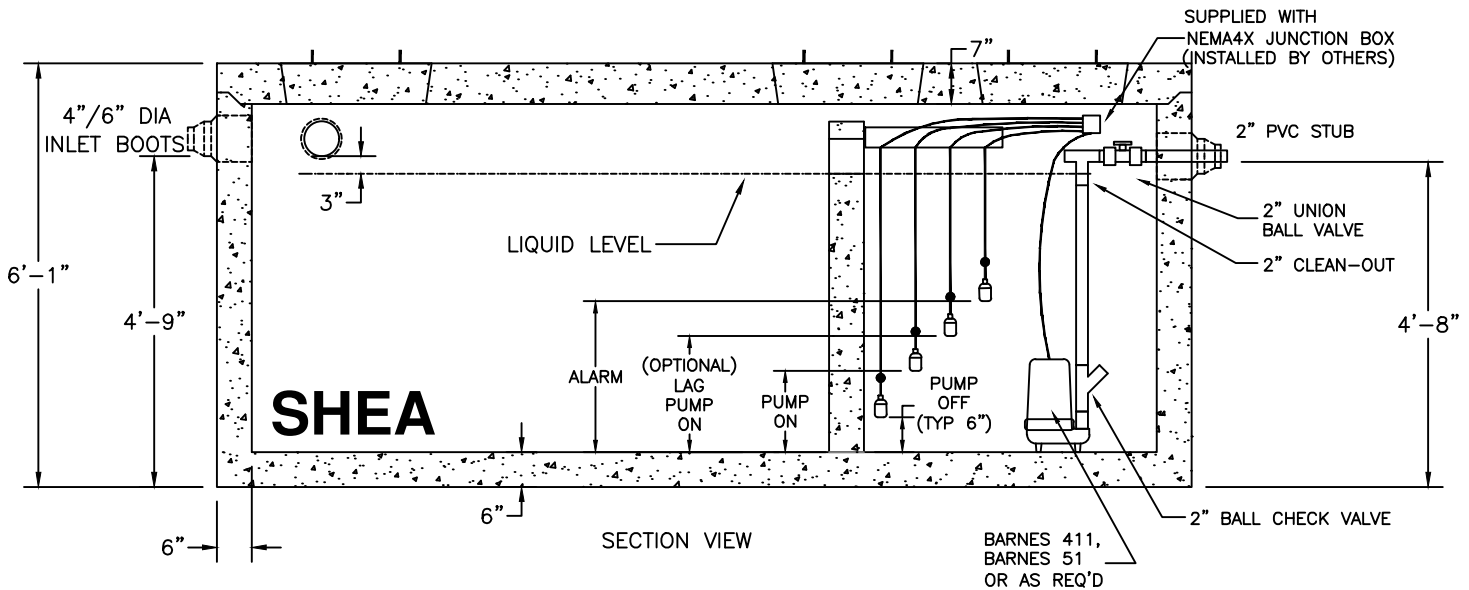

SECTION VIEW

NOTES:

1. CONCRETE: 5,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR 15.00, DEP TITLE 5 REGS, FOR SEPTIC TANKS.
4. BAFFLE WALL OPTIONAL FOR TWO COMPARTMENT TANKS.
5. DESIGNED FOR AASHTO HS-20 LOADING, COVER 1 TO 5 FEET.
6. TONGUE & GROOVE JOINT SEALED WITH BUTYL RESIN.
7. TEES AND BAFFLES SOLD SEPARATELY.

SHEA PRODUCT ID:	PREPARED FOR:	FILE NAME:	
WEIGHT (LBS): 37,470#	DRAWN BY: ARO	DATE: 06/01/18	
773 Salem Street-Wilmington, MA   153 Cranberry Hwy-Rochester, MA   87 Haverhill Road-Amesbury, MA   160 Old Turnpike Rd-Nottingham, NH			