


PLAN VIEW

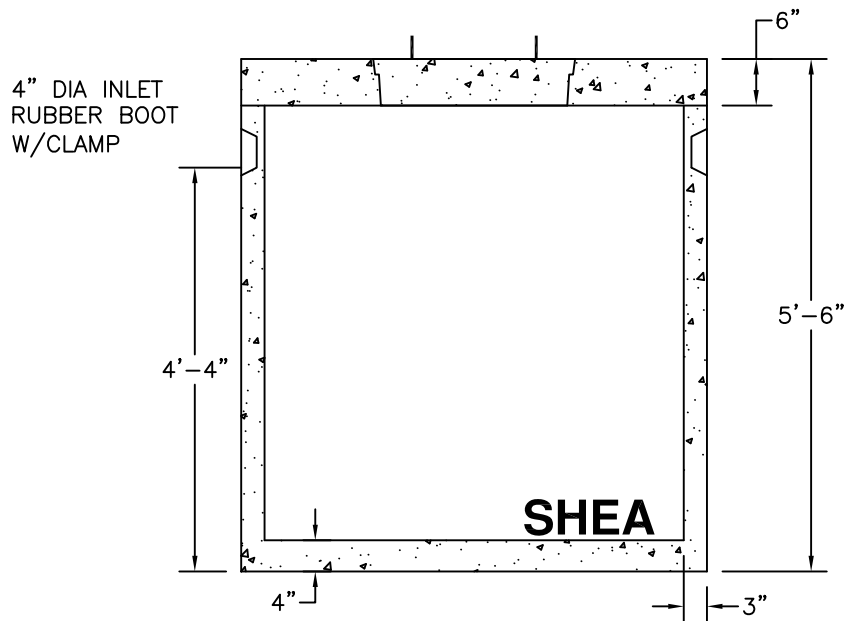

SECTION VIEW

NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR 15.000, DEP TITLE 5 REGS, FOR PUMP CHAMBERS.
3. ALL REINFORCEMENT PER ASTM C1227.
4. ALSO AVAILABLE IN H-20 LOADING.
5. JOINT SEALED WITH BUTYL RESIN.
6. PUMPS AND ACCESSORIES OPTIONAL.

			WEIGHT
ITEM NO.	TK-5X5PC	STANDARD	6,000#
	TK-5X5PCH	H-20	6,600#



*New England's Premier Precaster*  
 800-696-7432 (SHEA)  
 www.sheaconcrete.com

PUMP CHAMBER  
 500 GALLON

773 Salem Street—Wilmington, MA 153 Cranberry Hwy—Rochester, MA  
 87 Haverhill Road—Amesbury, MA 160 Old Turnpike Rd—Nottingham, NH  
 Mail to: PO Box 520—Wilmington, MA 01887

Page: C1.2

pc500.dwg

02/01/2013

