


PLAN VIEW

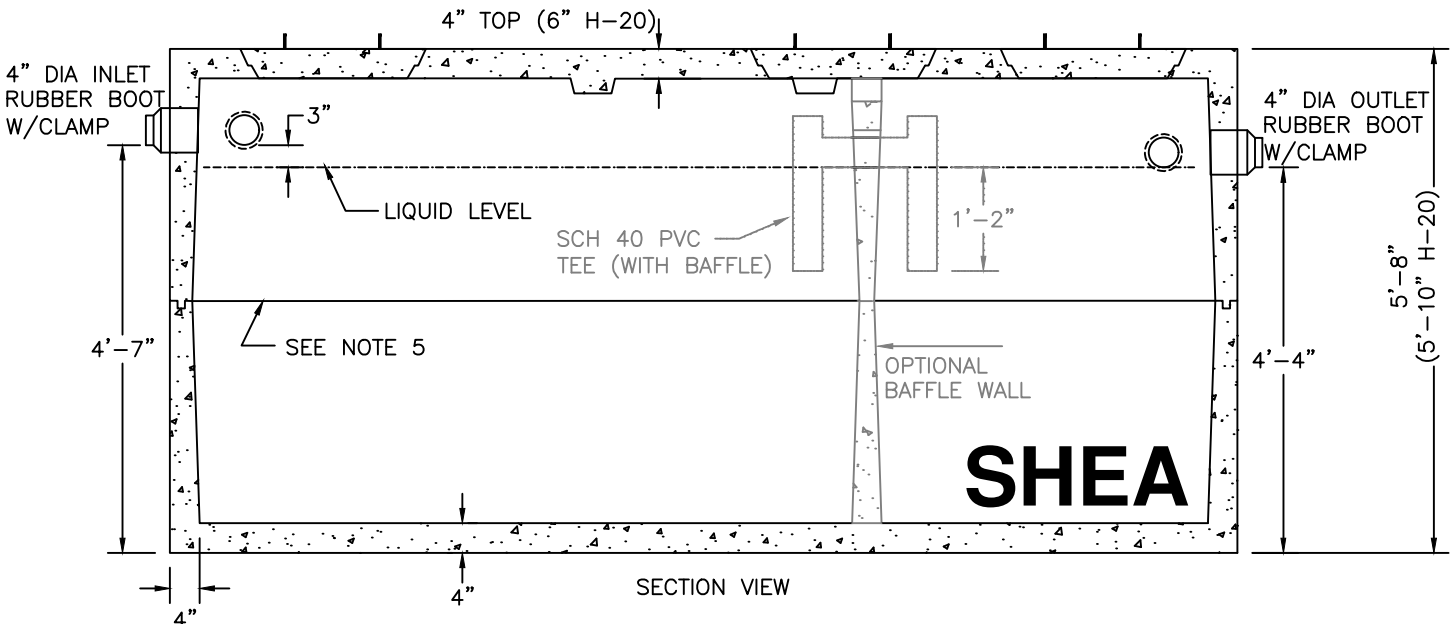

SECTION VIEW

NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. CONSTRUCTION OF SEPTIC TANK CONFORMS WITH 310 CMR, SECTION 15.00 DEP TITLE 5 REGS.
3. ALL REINFORCEMENT PER ASTM C1227.
4. BAFFLE WALL OPTIONAL FOR TWO COMPARTMENT TANKS.
5. TEES AND GAS BAFFLE SOLD SEPARATELY.
6. TONGUE & GROOVE JOINT SEALED WITH BUTYL RESIN.
7. IF COVER EXCEEDS 4 FEET, HEAVY DUTY TANK REQUIRED. ALSO AVAILABLE IN AASHTO HS-20 LOADING.

ITEM NO.	STANDARD	WEIGHT
2000	STANDARD	14,245#
2000H	H-20	16,170#
20002C	STANDARD	15,685#
20002CH	H-20	17,610#

SHEA PRODUCT ID: SEE TABLE

PREPARED FOR:

FILE NAME: tk2000.dwg

WEIGHT (LBS): SEE TABLE

DRAWN BY: ARO

DATE: 06/01/18

PAGE: B1.5

