


PLAN VIEW

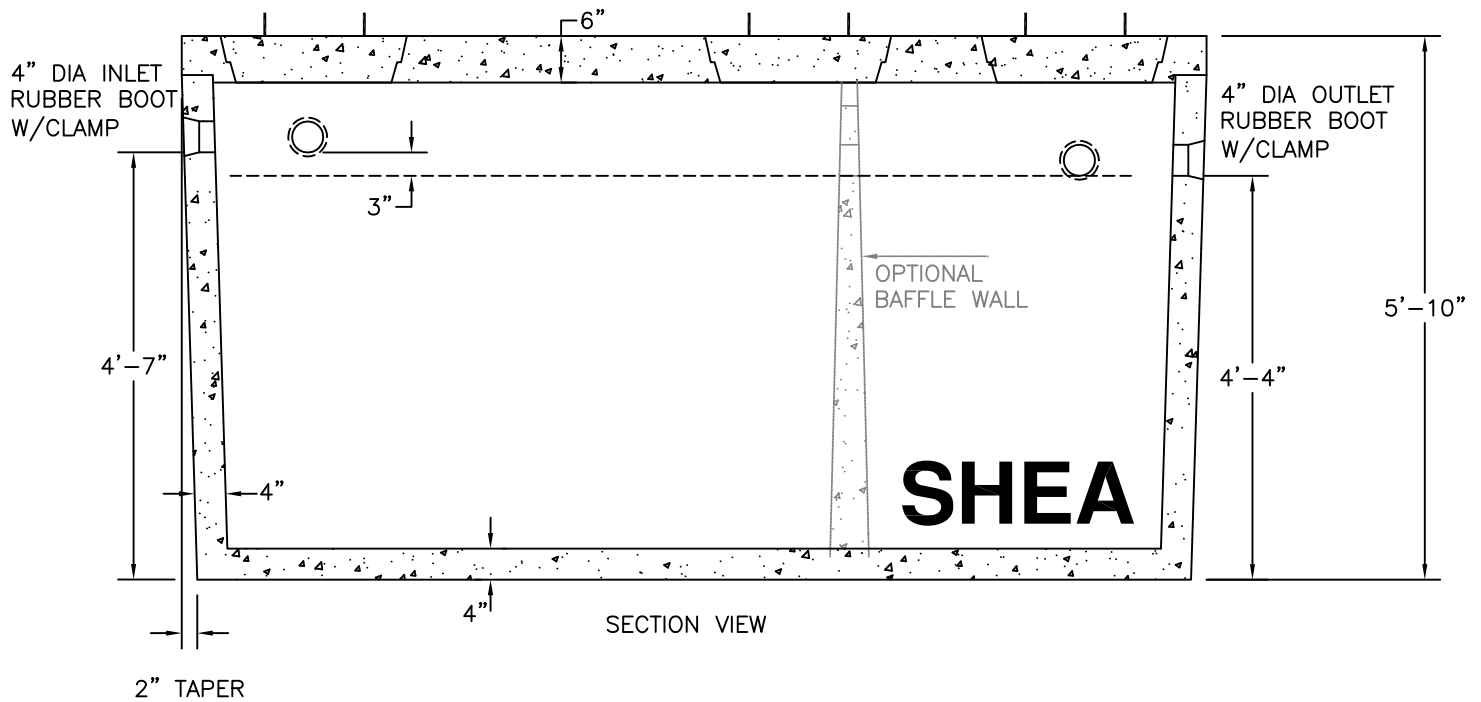

SECTION VIEW

NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR 15.00, DEP TITLE 5 REGS, FOR SEPTIC TANKS.
3. ALL REINFORCEMENT PER ASTM C1227.
4. BAFFLE WALL OPTIONAL FOR TWO COMPARTMENT TANKS.
5. TEES AND GAS BAFFLE SOLD SEPARATELY.
6. TONGUE & GROOVE JOINT SEALED WITH BUTYL RESIN.

			WEIGHT
ITEM NO.	TK-M1500H	HD	12,715#
	TK-M15002CH	HD	13,320#



New England's Premier Precaster
 800-696-7432 (SHEA)
 www.sheaconcrete.com

1500 GALLON SEPTIC TANK
 MONOLITHIC 4" WALL H-20

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA
 87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH
 Mail to: PO Box 520-Wilmington, MA 01887

Page: B2. 4

tkM1500-4.dwg

02/01/2013

