


PLAN

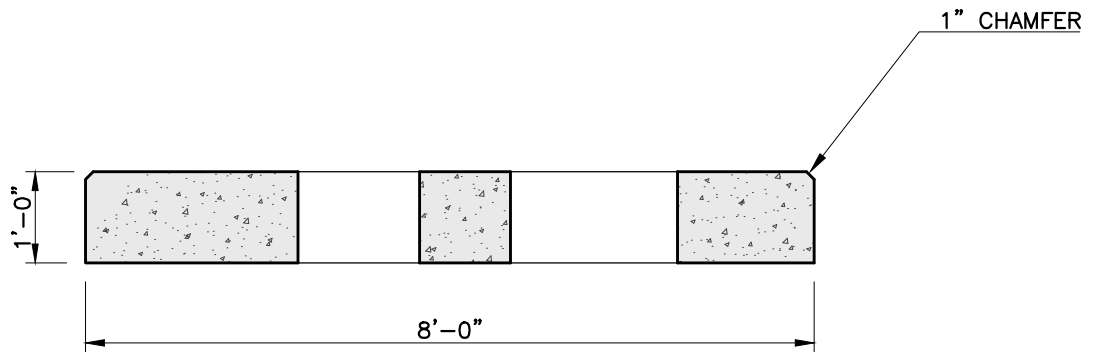

SECTION A-A

NOTES:

1. CONCRETE: 5,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN LOADING: AASHTO HS20-44, 0 TO 5 FEET COVER.
3. DESIGN SPECIFICATIONS - ACI 318 & AASHTO LOAD FACTOR DESIGN METHOD.
4. STEEL REINFORCEMENT CONFORMS TO ASTM A615, GRADE 60. MINIMUM COVER 1"

| | | | | | |
|------------------|----------|------------|------------------|-------|----------|
| SHEA PRODUCT ID: | BELDTP88 | FILE NAME: | BELD 225-1500KVA | | |
| WEIGHT (LBS): | 9280 | DRAWN BY: | L.P. | DATE: | 5/8/2018 |
| | | | | PAGE: | VIII.B.1 |

