



**PLAN**

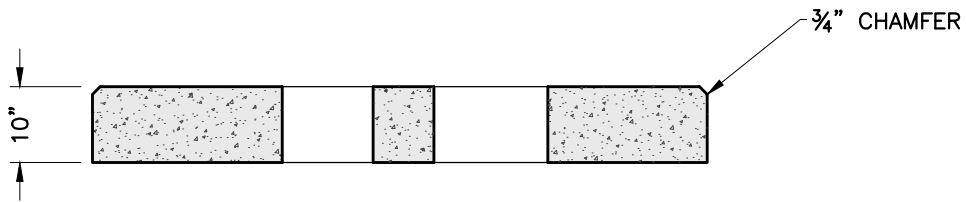

**SECTION A-A**

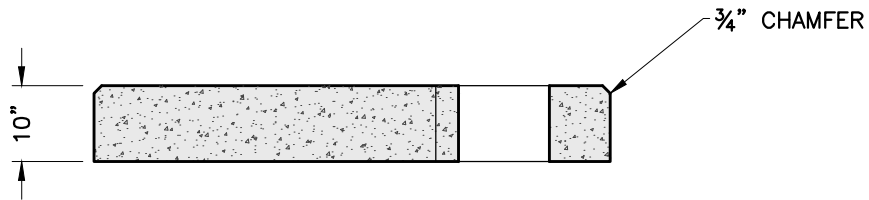

**SECTION B-B**

**NOTES:**

1. CONCRETE: 5,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN LOADING: AASHTO HS20-44, 0 TO 5 FEET COVER.
3. DESIGN SPECIFICATIONS - ACI 318 & AASHTO LOAD FACTOR DESIGN METHOD.
4. STEEL REINFORCEMENT CONFORMS TO ASTM A615, GRADE 60. MINIMUM COVER 1"

SHEA PRODUCT ID:	NGMS2582	FILE NAME:	NG 75-500KVA		
WEIGHT (LBS):	4040	DRAWN BY:	L.P.	DATE:	1/4/2017
				PAGE:	I.V.E.1

