


PLAN

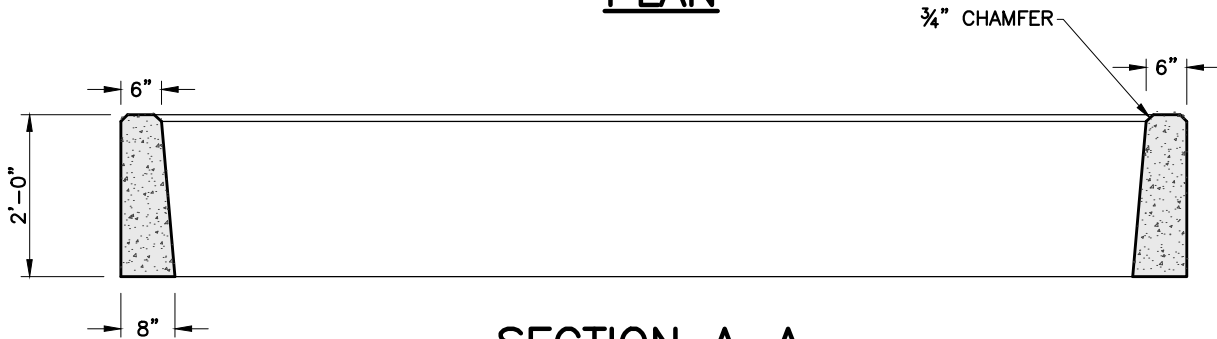

SECTION A-A

NOTES:

1. CONCRETE: 5,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN LOADING: AASHTO HS20-44, 0 TO 5 FEET COVER.
3. DESIGN SPECIFICATIONS - ACI 318 & AASHTO LOAD FACTOR DESIGN METHOD.
4. STEEL REINFORCEMENT CONFORMS TO ASTM A615, GRADE 60. MINIMUM COVER 1"

SHEA PRODUCT ID: **NGOC124X142**

FILE NAME: **NG CURB500KVA**

WEIGHT (LBS): **5365**

DRAWN BY: **L.P.**

DATE: **1/4/2017**

PAGE: **IV.E.2**

