



COLLAR "A"
15kV SG COLLAR
PLAN

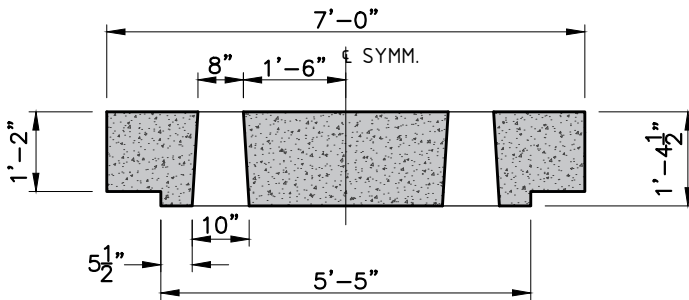

SECTION A-A

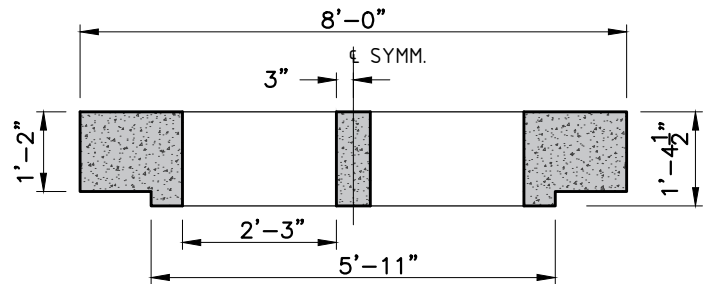

SECTION B-B

NOTES:

1. CONCRETE: 5,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN LOADING: AASHTO HS20-44, TOP AT SURFACE.
3. DESIGN SPECIFICATIONS - ACI 318 & AASHTO LOAD FACTOR DESIGN METHOD.
4. STEEL REINFORCEMENT CONFORMS TO ASTM A615, GRADE 60. MINIMUM COVER 1"
5. CONSTRUCTION JOINT SHALL BE SEALED WITH 1"Ø BUTYL RUBBER OR APPROVED EQUAL.

SHEA PRODUCT ID:	NGSGCA	FILE NAME:	NGSWG COLLAR A		
WEIGHT (LBS):	9610	DRAWN BY:	L.P.	DATE:	1/3/2017
				PAGE:	IV.D.3

