


PLAN VIEW

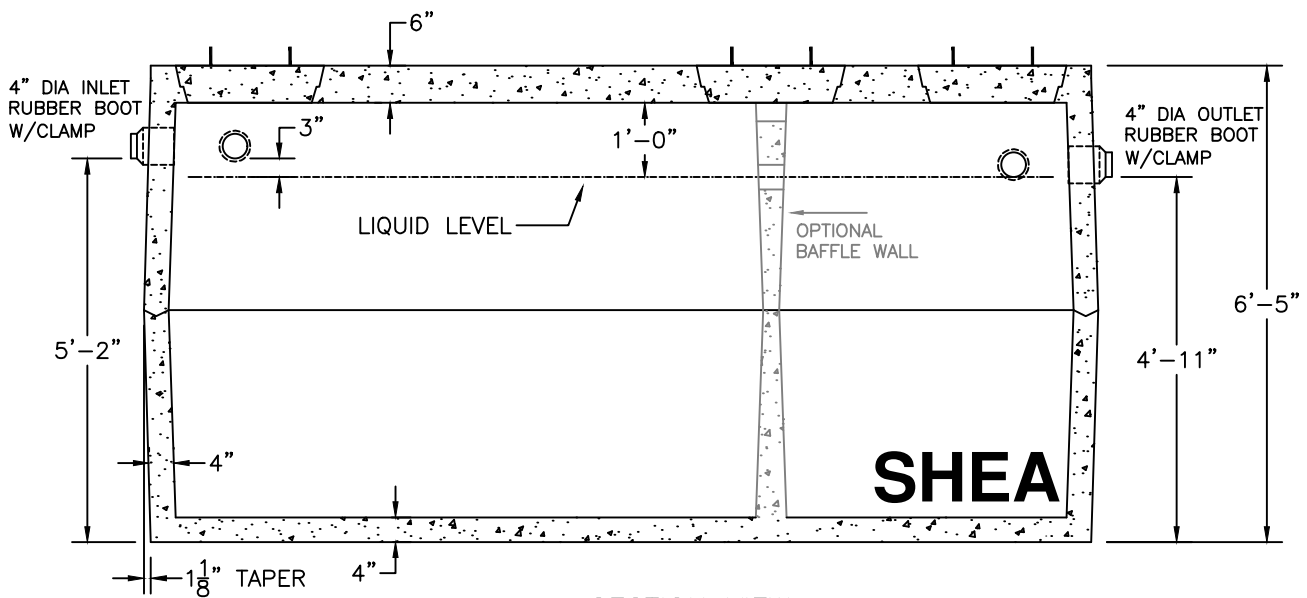

SECTION VIEW

NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. CONSTRUCTION OF SEPTIC TANK CONFORMS WITH 310 CMR, SECTION 15.00 DEP TITLE 5 REGS.
3. ALL REINFORCEMENT PER ASTM C1227.
4. TEES AND GAS BAFFLE SOLD SEPARATELY.
5. TONGUE & GROOVE JOINT SEALED WITH BUTYL RESIN.
6. IF COVER EXCEEDS 4 FEET, HEAVY DUTY TANK REQUIRED. ALSO AVAILABLE IN AASHTO HS-20 LOADING.

ITEM NO.	STANDARD	WEIGHT
2500	STANDARD	21,750#
2500H	H20	21,750#
25002CH	H20	22,650#
25002CH	H20	22,650#

SHEA PRODUCT ID: SEE TABLE

PREPARED FOR:

FILE NAME: tk2500.dwg

WEIGHT (LBS): SEE TABLE

DRAWN BY: ARO

DATE: 06/01/18

PAGE: B1.6

