



PLAN VIEW

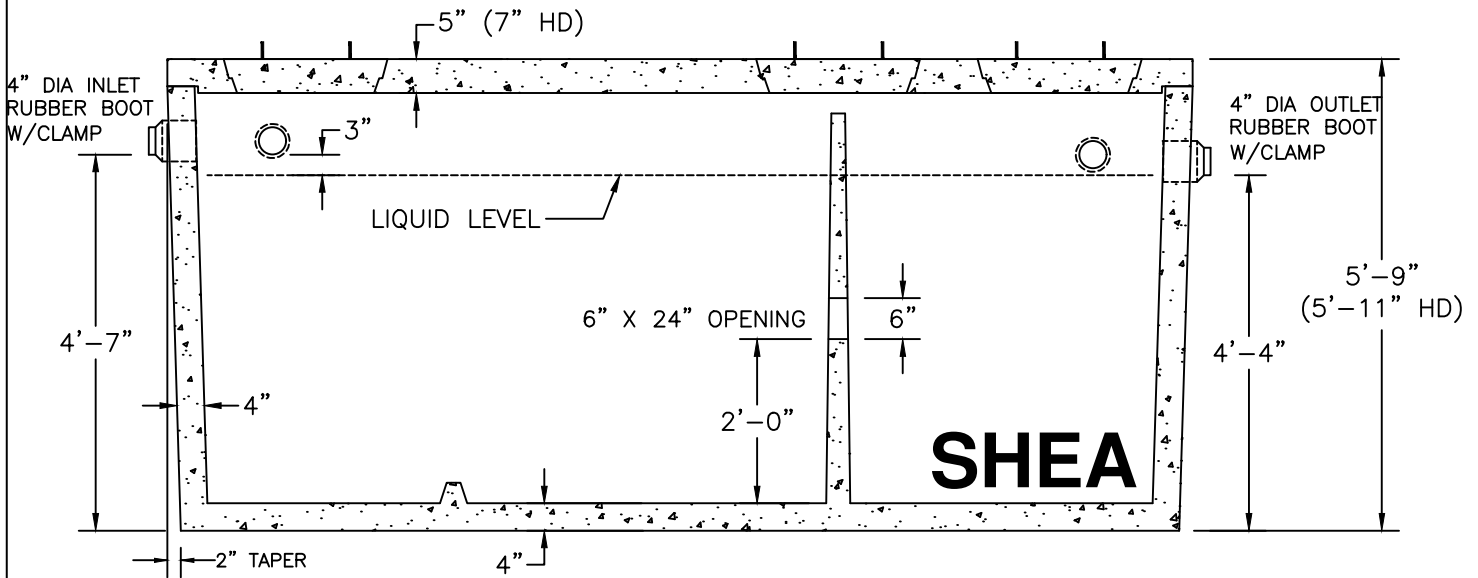

SECTION VIEW

NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR, SECTION 15.00 DEP TITLE 5 REGS FOR SEPTIC TANKS
3. ALL REINFORCEMENT PER ASTM C1227.
4. BAFFLE WALL OPTIONAL FOR TWO COMPARTMENT TANKS.
5. TEES AND GAS BAFFLE SOLD SEPARATELY.
6. TONGUE & GROOVE JOINT SEALED WITH BUTYL RESIN.
7. IF COVER EXCEEDS 4 FEET, HEAVY DUTY TANK REQUIRED. ALSO AVAILABLE IN AASHTO HS-20 LOADING.

SHEA PRODUCT ID: MC20002CWS/M20002CWSH	PREPARED FOR:	FILE NAME: tkm20002CWS.dwg	
WEIGHT (LBS): 19,150#/21,150#	DRAWN BY: ARO	DATE: 06/01/18	
773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA 87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH			